



A1-(6) AND A1-(8)

NTS

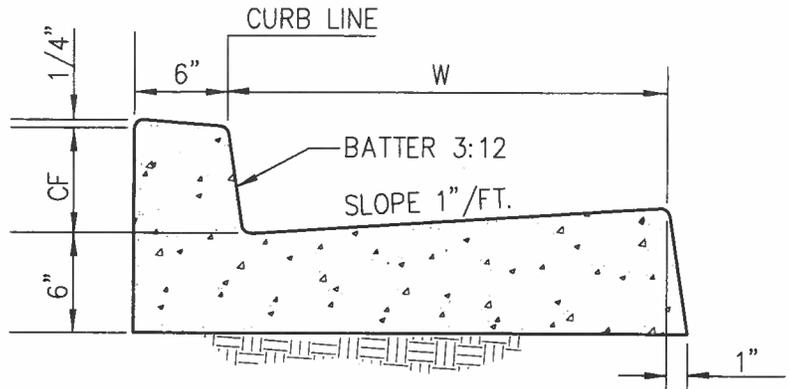


A2 -(6) AND A2-(8)

NTS

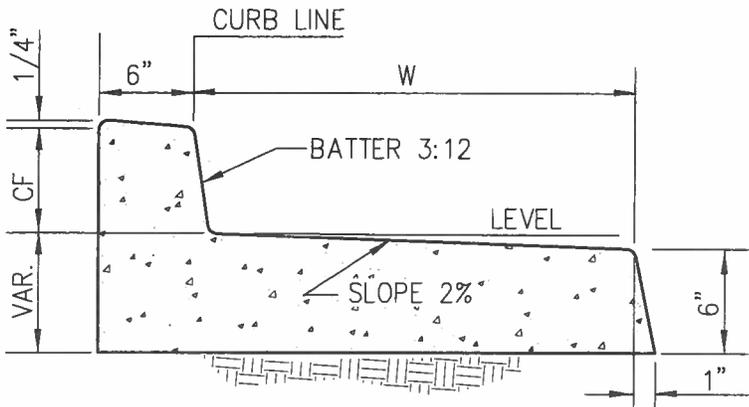

A3-(6) AND A3-(8)

NTS

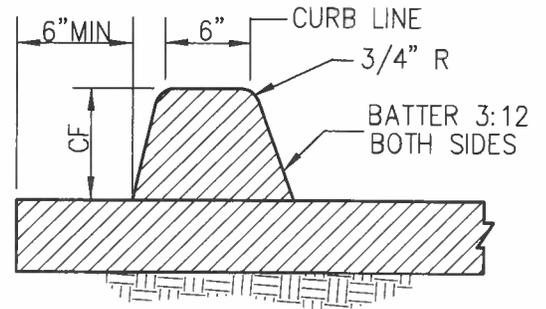


D1-(6) AND D1-(8)

NTS

NOTES:

1. THE LAST NUMBER IN THE DESIGNATION IS THE CURB FACE (CF) HEIGHT.
2. GUTTER WIDTH, W, IS 18" OR 24" AS SPECIFIED ON THE PLAN.
3. TYPES A1, A2, A3 AND C1 SHALL BE CONSTRUCTED FROM PCC.
4. TYPE D1 CURB SHALL BE CONSTRUCTED FROM ASPHALT CONCRETE.
5. TYPE C1 CURB SHALL BE ANCHORED WITH STEEL DOWELS AS SHOWN OR WITH AN EPOXY APPROVED BY THE CITY'S REPRESENTATIVE.
6. ALL EXPOSED CORNERS ON PCC CURBS AND GUTTERS SHALL BE ROUNDED WITH A 1/2" RADIUS.
7. CONCRETE MIX SHALL BE 560-C-3250

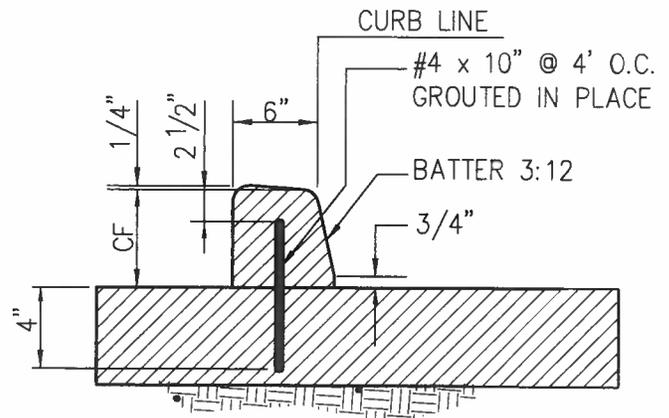

C1-(6) AND C1-(8)

NTS



CITY OF SANTA PAULA - PUBLIC WORKS DEPARTMENT

STANDARD PLAN

CURB AND GUTTER - BARRIER

405

APPROVED BY:

Clifford G. Finley
PUBLIC WORKS DIRECTOR / CITY ENGINEER

2-2-09
DATE

SHEET 1 OF 1